


Model Number	Nominal Size (Inches) W x H x D	Actual Size (Inches) W x H x D	Rated Airflow (CFM)	Initial Resistance (In W.G.)	Media Area (Square Feet)
XPH-STD4-410	12 X 24 X 4	11-3/8 X 23-3/8 X 3-3/4	1000	0.15	13.0
XPH-STD4-401	16 X 20 X 4	15-1/2 X 19-1/2 X 3-3/4	1120	0.15	14.9
XPH-STD4-402	16 X 25 X 4	15-1/2 X 24-1/2 X 3-3/4	1400	0.15	18.8
XPH-STD4-412	18 X 24 X 4	17-3/8 X 23-3/8 X 3-3/4	1500	0.15	19.7
XPH-STD4-403	20 X 20 X 4	19-1/2 X 19-1/2 X 3-3/4	1400	0.15	18.5
XPH-STD4-411	20 X 24 X 4	19-3/8 X 23-3/8 X 3-3/4	1670	0.15	22.2
XPH-STD4-404	20 X 25 X 4	19-1/2 X 24-1/2 X 3-3/4	1750	0.15	23.3
XPH-STD4-405	24 X 24 X 4	23-3/8 X 23-3/8 X 3-3/4	2000	0.15	26.5

* Reverse Pleat

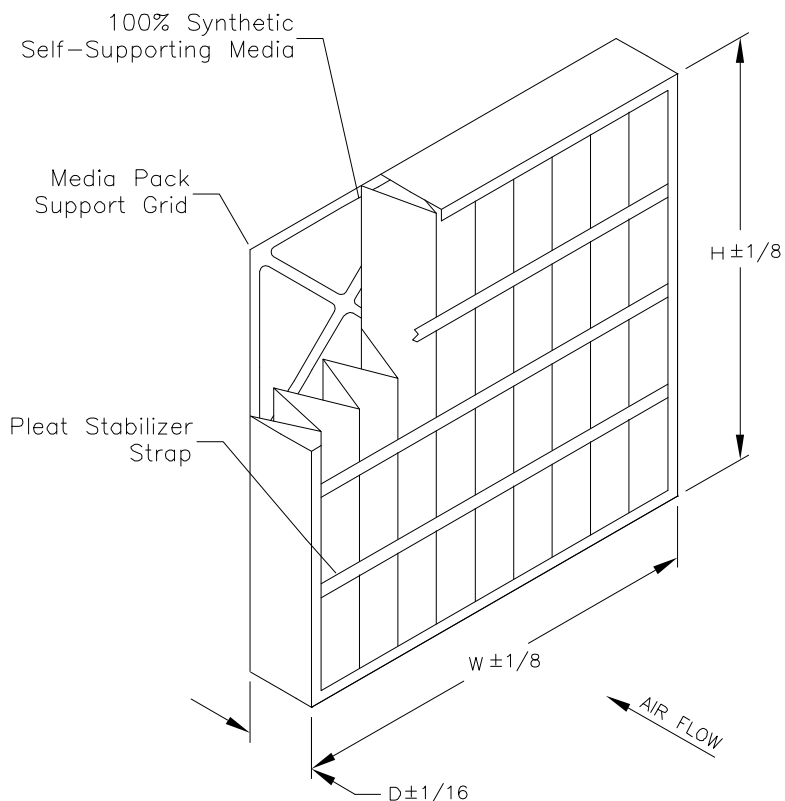

STANDARD CONSTRUCTION


1. 100% Synthetic, Self-Supporting Media
2. 11.3 Pleats per Foot
3. (3) Pleat Stabilizer Straps, Upstream Side
4. Media Pack Support Grid, Downstream Side
5. Moisture Resistant Beverage Board Frame

NOTES

1. Average Efficiency: MERV 8 ASHRAE 52.2-2012
Tested at 492 FPM on 24x24x1 nominal size.
2. MERV-A 8-A ASHRAE 52.2-2012 Appendix J
3. Final Resistance: 1.0" W.G.
4. Rated Velocity: 500 FPM
5. Classified Per UL Standard 900 For Flammability
6. Maximum Operating Temperature: 150 deg. F

	100 River Ridge Circle Jeffersonville, IN 47130 P: 866-247-4827 F: 866-801-1809 www.dlcair.com/airguard
	CONTACT FACTORY TO VERIFY REVISION LEVEL

TOLERANCES UNLESS OTHERWISE SPECIFIED	
FRACTIONAL	-
DECIMAL	-
ANGLES	-
ALL DIMENSIONS IN INCHES	

DRAWING NAME XTREME-PLUS HIGH CAPACITY SSP 4" DEPTH			
APPROVED BY		SPECIFICATION NO.	MKT-B-00610
SCALE	NONE	DWG. SIZE	A
		REVISION	E
		REVISION DATE	05-19-15
<small>CONFIDENTIAL - DO NOT COPY. THIS MATERIAL IS TRADE SECRET AND PROPRIETARY BEING EXCLUSIVELY OWNED BY CLC AIR. THE EXPRESSION OF THE INFORMATION CONTAINED HEREIN IS PROTECTED UNDER FEDERAL COPYRIGHT LAWS AND ALL COPYING IS PROHIBITED AND MAY BE SUBJECT TO CRIMINAL PENALTIES.</small>			